

Products, Glazing Techniques and Maintenance Appearance/Visual Quality Specification for Insulating Glass Units and Maintenance

4.10 January 2010

Contents

1. Introduction
2. Scope
3. Definitions
4. Glass types
5. Optical Quality
6. Visual Quality
7. Inherent characteristics of IGUs
8. Appearance
9. Method of assessment
10. Acceptance criteria
11. References

Annex A / Annex B

1. Introduction

The appearance/visual quality of an insulating glass unit (IGU) is dependent on the following:

- Optical quality of the component glass panes, i.e. distortion inherent with the production of the glass pane;
- Visual quality of the component glass panes, i.e. number/size/type of defects; Inherent characteristics of an IGU, i.e. behaviour of a hermetically sealed body;
- Processing, handling, and glazing techniques.

2. Scope

This Data Sheet details all appropriate optical and quality factors of the glasses used to manufacture the IGU, that influence the appearance of an installed IGU.

It should be borne in mind that the major criterion is the view through the IGU from the inside of a building. This is covered in detail within this Data Sheet.

However, it is appreciated that the appearance from the outside of the building, i.e. in reflection, can also be important in certain applications and some non-specific comments are made on this subject.

3. Definitions

For the purpose of this Data Sheet the following definitions apply:

3.1 Appearance

The overall effect on the observer when looking at objects through the IGU.

3.2 Optical quality

The distortion in the appearance of an object when observed through the glass.

3.3 Visual quality

The effect of faults, e.g. spot, linear extended, etc., on the vision through the glass.

3.4 Transparent glass

Glass that transmits light and permits clear vision through it.

3.5 Textured and translucent glass

Glass that transmits light with varying degrees of light scattering so that vision is not clear, providing some privacy; or glass that had been sand blasted or acid etched, or laminated glass with a white interlayer making the glass translucent.

3.6 Insulating glass unit (IGU)

An assembly consisting of at least two panes of glass, separated by one or more spacers, hermetically sealed along the periphery, mechanically stable and durable.

3.7 Condensation

The presence of moisture and/or other liquid on a glass surface either inside or outside the IGU.

3.8 Interstitial condensation

Condensation that occurs within the hermetically sealed cavity of the IGU.

3.9 Peripheral condensation

Condensation that occurs on the inside, i.e. room surface, of the IGU around the edge of the unit adjacent to the frame.

3.10 External condensation

Condensation that occurs on the external, i.e. outside surface, of the IGU



Glass and Glazing Federation

Glass and Glazing Federation
54 Ayres Street, London. SE1 1EU
Tel: 020 7939 9101 Fax: 0870 042 4266
www.ggf.org.uk

While every attempt is made to present up to date information, this data sheet, produced by the Glass and Glazing Federation, is issued for guidance but without responsibility for any advice given therein or omission therefrom or for the consequences of acting in reliance thereon and all liability on the part of the Glass and Glazing Federation however arising in connection therewith is expressly disclaimed.

4. Glass types

4.1 General

The IGU manufacturer uses glass panes within the IGU that comply with other standards as to their optical and visual quality. In general the IGU manufacturer cannot alter these quality characteristics. During the IGU manufacturing process, and in subsequent handling, there is a risk that further visual faults, e.g. scratches, scuffs, could be added to those already present in the components.

The standards relating to the appropriate glass products will detail their optical and visual quality pertaining to the individual pane.

4.2 Basic and special basic glasses

These are annealed glasses that comply with one of the following standards:

BS EN 572 - Parts 2 to 6 or Part 8

BS EN 1748 - 1 - 1

BS EN 1748 - 2 - 1

BS EN 14178 - 1

Note: Typically annealed soda-lime silicate glass, i.e. BS EN 572 is used. Specialist glasses are normally used for specific purposes, e.g. fire resistant glazing.

4.3 Toughened, toughened and heat soaked, or strengthened glasses

These are annealed glasses that have been thermally or chemically treated to modify their strength and breakage characteristics. They will comply with one of the following standards:

BS EN 1863 - 1

BS EN 12150 - 1

BS EN 12337 - 1

BS EN 13024 - 1

BS EN 14179 - 1

BS EN 14321 - 1

4.4 Laminated glasses

These are annealed, toughened or heat strengthened glasses, in any combination, that have been combined with an interlayer(s) to produce a product with modified characteristics. These modifications will affect one or more of the following:

- post-breakage behaviour
- spectrophotometric characteristics
- acoustic characteristics
- resistance to penetration

They will comply with the following standards:

BS EN ISO 12543 - Parts 1 - 6, and BS EN 14449

4.5 Coated glasses

A glass substrate of any of the above, that either incorporates a coating within the glass surface or has had a coating applied to the surface. The coatings are designed to modify the spectrophotometric characteristics of the glass. They will comply with the following standard:

BS EN 1096 - Parts 1 - 3

5. Optical Quality

5.1 General

The optical quality of a glass component is the result of the following:

- the method of manufacture of the glass component; together with
- the effect of any subsequent processing.

5.2 Basic and special basic glasses

The optical quality of transparent glass is entirely dependent on the manufacturing method.

Generally glass made by the float process has less distortion and manufacturing faults than drawn sheet glass. Depending on the specific product, e.g. drawn sheet glass, there may be a number of classes for optical quality.

Polished wired glass can be visually as good as float glass, but the presence of the wire mesh may affect the optical appearance and it has its own section within the standards.

Cast glass, patterned glass and wired patterned glass are all textured glasses with varying degrees of light scattering disruption. These products do not have a specific optical quality.

5.3 Toughened or strengthened glasses

Thermal toughening and heat strengthening processes may adversely affect the optical quality of the float or drawn sheet glass that is processed. The heating and cooling of the glass during the process can result in bow, overall and/or local, and/or roller wave distortion² that will reduce the optical quality from that of the unprocessed glass.

Note: Any lack of flatness with thermally treated glasses can produce problems with reflected images. See Annex A for an example.

Chemical strengthening is less likely to affect the optical quality of the unprocessed glass.

5.3.1 Specific effects of thermal treatment process

The process may give rise to a degree of haze, i.e. a cloudy look to the surface, especially at oblique angles of incidence.

The process may, under some viewing conditions, result in an effect that is known as anisotropy (iridescence). This is the result of stress patterns in the cross section of the glass becoming visible. These areas of stress produce a bi-refrident effect in the glass, which is visible in polarised light. When viewed in polarised light these areas show up as coloured zones, sometimes referred to as 'leopard spots'. The bi-refrident effect is more noticeable at glancing angles. This is not considered as a fault in the glass and is a naturally occurring phenomenon.

5.4 Laminated glasses

The optical quality of laminated glass is dependent on the following:

- type and number of glass panes
- type, thickness and number of interlayer(s)
- presence or not of plastics glazing sheet materials
- laminating process, e.g. folio, cast in place, etc.

Generally folio lamination processes, i.e. ones using an interlayer such as pvb, eva, pvc, have only minor influences on the optical quality of the final product. The degree of influence will increase

with more panes of glass and more/thicker interlayers as a result of possible multiple panes of glass each having the potential for an isolated fault.

² Details on allowable bow and how it is measured are given in the product standards. Specific details relating to roller wave, including method of measurement, is given in GGF Data Sheet 4.4.

Cast in place laminating is more likely to result in a product that does not have parallel faces, and hence distortions may occur. Problems may occur with slight discrepancies in uniformity of curing of the interlayer that may produce refractive index discrepancies.

5.5 Coated glasses

The optical quality of coated glass is dependent on the following:

- type of glass substrate
- type, thickness and make-up of coating, e.g. single or multilayer;
- coating process, e.g. on-line, off-line, etc

Generally the addition of a coating to a glass substrate does not significantly alter the optical quality. Therefore the optical quality of a coated glass is that of the substrate. Coatings are added to influence thermal efficiency, solar control, reflective properties, or cleaning attributes, and may change the light transmittance or reflectance of the product.

However, as the majority of coatings work due to thin film interference effects there can be a perceived change if there is a lack of uniformity in the coating. Similarly these thin coatings can offer variations in colour that can appear as a lack of uniformity. Modern low-e coatings on glass may produce a haze, i.e. a cloudy look to the surface, when viewed in oblique lighting (see 8.3).

6. Visual Quality

6.1 General

The visual quality of a glass component is the result of the following:

- method of manufacture of the glass component; together with
- effect of any subsequent processing and handling.

6.2 Basic and special basic glasses

The visual quality of basic glass products can be found for stock sizes in the product standards (see 4.2).

The visual quality for final cut sizes is given in the product standards for special basic glasses. The visual quality of basic soda lime silicate glass products is given in BS EN 572 Part 8.

Cutting down of stock plates into final cut sizes, i.e. panes for further processing, is an opportunity to reduce the number and size of inherent spot and/or linear extended faults. However, care should be taken to ensure that the cutting process does not introduce other defects, i.e. scratches.

The visual quality of textured glasses also depends on the following:

- pattern type/depth
- directionality of the pattern
- wire mesh uniformity, squareness, alignment etc.

Quantification of these parameters can be found in the appropriate product standards.

Generally the visual quality is higher for a transparent glass than for a textured or translucent glass. With textured glasses the light scattering reduces the visible impact of the faults. Therefore the greater the degree of light scattering the less likely is it that any specific fault is visually disturbing.

6.3 Toughened or strengthened glasses

As these products are manufactured from final cut sizes then the processing should not alter the basic visual quality of the glass. However, the cutting, edge working and toughening/strengthening could impart additional scratches/scuffs onto the glass surface. These processing faults will affect the visual quality.

The thermal treatment process may result in small imprints in the surface ('roller pick-up'). This only applies to horizontally processed glass thicker than 8mm.

6.4 Laminated glasses

The visual quality of laminated glass depends on the following:

- component glass panes
- interlayer type, thickness
- laminating process
- cutting/sawing to final cut size

The manufacture of stock size laminated glass is influenced by the visual quality of the initial stock size glass panes used. These panes will have a visual quality in accordance with the product standards (see 4.2). The visual quality of the laminated glass may be worse than that of any component pane. Therefore the greater number of glass panes within a laminated glass the greater the likely number of defects (see BS EN ISO 12543 Part 6).

With selective cutting of finished sizes from stock plate of laminate glass some defects can be avoided in the final product.

Further faults can be introduced during the laminating process due to faults in the interlayer; and entrapment of any contamination between the layers. Defects can appear as bubbles, opaque spots, foreign bodies, and creases in the interlayer.

Cutting, sawing and edge working can impart scratches etc. The thicker/heavier the laminated glass then the higher is the probability of increasing the visual defects during these processes. This applies to all glass types.

6.5 Coated glasses

The visual quality of coated glass depends on the following:

- component glass panes
- coating type, colour, spectrophotometric properties
- coating process
- cutting to final cut size

The presence of a coating on a glass substrate may increase the visibility of a spot fault, linear extended fault within the substrate. Similarly faults within and/or on the coating, e.g. pinholes, scratches, scuffs, non-uniformities, etc., may decrease the visual quality. These effects are more pronounced with coatings that are highly coloured and/or highly reflective.

The likelihood of the visual quality being decreased is dependent on the type of coating process and the number of steps involved within the coating process.

Generally on-line coating is inherently more resistant to scratching, etc. than are off-line coatings. Certain 'soft' off-line coatings need special processing, i.e. edge stripping, prior to incorporation into an IGU. This abrasion process can also result in decreased visual quality.

7. Inherent characteristics of IGUs

7.1 General

An insulating glass unit as defined is a glass product that contains hermetically sealed air space(s). The air space(s) are filled with dehydrated air or other gas, e.g. argon, etc. The IGU is intended to reduce the rate of heat loss and therefore influence the formation of condensation (see 7.2).

7.1.1 Characteristics of the hermetically sealed cavity

The properties of a hermetically sealed cavity are that they will change dependent on the following:

- temperature and barometric pressure when the cavity was sealed
- actual air temperature and barometric pressure
- temperature of the air or gas within the cavity as a result of radiation etc.
- thickness of the glass

These changes will result in a volume change in the cavity. This will result in the unit taking up either a concave or convex shape. This shape will cause a number of phenomena to become apparent (see 7.3, 7.4, 7.5).

7.2 Condensation

An IGU is designed to reduce the heat loss through the glazing. This means that, compared to single glazing, the incidence of moisture condensing on the room side glass surface is reduced. However, condensation can still occur as follows:

- a. Internal condensation can still occur if the glass surface is the coldest surface in a room and the relative humidity is extremely high, i.e. in a kitchen, bathroom, etc. with large amounts of steam/moisture present.
- b. Interstitial condensation occurs either when the unit seal has failed and the cavity is saturated with moisture or when an internal component, e.g. Georgian bars, etc., has deteriorated and given off organic solvents. Under both of these conditions the appearance of condensation on one or both cavity surfaces can occur subject to the glass surface temperature.
- c. Peripheral internal condensation occurs with units having low U-values and is the result of localised heat flow through the spacer of the unit. Using more insulating framing, and/or so-called 'warm edge technology' can help reduce this.
- d. External condensation occurs with units having low U-values. With the amount of heat being lost through the unit being significantly reduced the outer glass pane can be colder than for less well insulated units.

Therefore under localised climatic conditions this can lead to moisture condensing out of the atmosphere onto the outside surface of the unit. This is not a fault, and can be seen as the product being effective in keeping heat in.

7.3 Interference phenomena

These are visual phenomena, similar to oil on water, and are the result of light interference patterns due to the IGU glass panes deflecting in relation to each other:

7.3.1 Brewster's fringes

The appearance of the optical phenomena known as Brewster's Fringes is not a defect of the insulating glass unit and can occur with any glass of high optical and surface quality, i.e. float glass. This phenomenon is a result of the high quality now being achieved by glass manufacturers.

Brewster's Fringes occur if wavelengths of light meet up with each other when they are exactly 180° out of phase. This is an example of the phenomena known to physicist as the interference of light. The effect is similar to, although usually much smaller than, the interference fringes that can sometimes be seen on toughened glass windscreens.

Brewster's Fringes occur when the surfaces of the glass are optically flat and the two panes are parallel to each other; i.e. when the light transmission properties of the installation are of a very high order. This phenomenon is not a defect of the product and is solely dependent on the laws of physics.

7.3.2 Newton's rings

This optical effect only occurs in faulty/defective insulating glass units when the two panes of glass are touching or nearly touching in the centre. The optical effect is a series of concentric coloured rings with the centre being at the point of contact/near contact of the two panes. The rings are roughly circular or elliptical.

7.4 Multiple images

As a result of the number of reflective surfaces (four in an IGU with two glass panes manufactured from monolithic glass) there exists the likelihood of multiple images being formed. Whilst this is only of minor significance when the observer is looking directly through the IGU, i.e. at normal incidence, this will increase considerably as the angle of incidence.

The presence of other reflective surfaces, e.g. laminated glass, coatings, may enhance the phenomena. Also any deflection effect within the unit may have an influence.

Annex B will give a diagrammatic representation of the phenomena resulting from the inherent properties of an insulating glass unit.

7.5 Reflected image

As a result of the hermetically sealed cavity of an IGU the glass will deflect with changes of temperature and pressure. The result of this is that in reflection the reflected images can appear separated. This will be further exacerbated by the presence of multiple images that are being displaced different amounts.

The likelihood of this occurrence is dependent on the extent of the deflection in the IGU as a result of the difference in atmospheric temperature and pressure between the manufacturing conditions and the service conditions.

The effect may be more noticeable when reflective coatings are incorporated within the IGU.

Annex B will give a diagrammatic representation of the phenomena resulting from the inherent properties of an insulating glass unit.

8. Appearance

8.1 General

Appearance relates to the limitations that are placed upon the insulating glass unit manufacturer: These limitations are as a result of the following:

- Incoming glass components,
- Specification of the unit,
- Inherent properties of the unit, and last but not least,
- Framing and glazing systems.

The perceived appearance of an installed IGU can be adversely affected by distortions induced by the framing system and the installation.

8.2 Normal incidence

The IGU should be viewed at normal incidence, i.e. at 90° to the glass surface.

For IGUs containing transparent glass components the appearance relates to the vision through.

For IGUs containing textured or translucent glass components the appearance relates to the visual quality of the textured or translucent glass component.

8.3 Oblique incidence

The effects such as multiple images, haze, etc. are inherent characteristics of an IGU when viewed at angles of incidence less than 60° to the surface.

8.4 Reflection

Not generally considered. See Annexes A and B for further information.

9. Method of assessment

9.1 General

The standards for the component glass panes detail the method of observation and the distance and criteria for acceptance. However, in an IGU no such recommendations are given in the applicable European standard, i.e. BS EN 1279-1.

As there is no standardised method of assessment this Data Sheet lays down an appropriate methodology.

Damage caused by following trades after glazing will not be considered as a fault of the installer. For example damage can be caused by impact, scratching, deposit of plaster, cement, etc, and weld spatter and spatter from cutting tools. For this reason, viewing IGUs for scratches or other damage on the outer faces of the panes must be carried out before any following trades works adjacent to the glazing, and as early as reasonably practicable following installation of the IGUs.

9.1.1 Area of IGU to be examined

The glass area to be viewed is the entire vision area with the exception of a 50mm wide band around the whole perimeter of each of the glass panes.

See Figure 1.

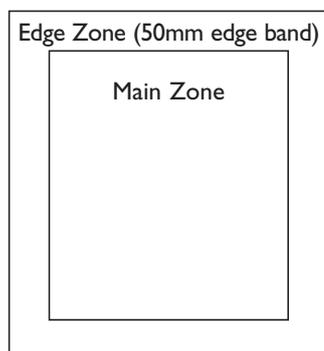


Figure 1

This edge zone, in terms of size, is similar to that given for the determination of coated glass in final cut sizes (see BS EN 1096-1).

9.2 Inspection

The IGUs shall be viewed at near normal incidence, i.e. at right angles, to the glass surface from the room side, standing at a distance of not less than 2 metres away from the inner glass surface for annealed float glass and 3 metres away for all other glass types e.g laminated or toughened glass.

The assessment of visual quality of the panes of glass should be carried out in natural daylight but not in direct sunlight and with no visible moisture on the surface of the inner or outer glass panes. The use of strong lamps and/or magnifying devices is not allowed.

It is not permissible to find defects at close range and then mark them so as to be visible from the given viewing distance.

Obtrusiveness of faults shall be judged by looking through the glass, not at it.

10 Acceptance criteria

10.1

Acceptance criteria relate strictly to the inherent characteristics of an IGU or of the glasses used to make up an IGU, such as:- totally enclosed seeds, bubbles or blisters; hairlines or blobs; and minute embedded particles; and inherent faults and fine scratches on coated glasses.

IGUs with optical defects such as smears, finger prints or other dirt on the cavity faces of the glass' or extraneous material inside the IGU cavity are unacceptable, and this applies also to any such defects within the 50mm edge zone.

Insulating glass units shall not be deemed unacceptable for any phenomena relating to the inherent characteristics of an IGU with the exception of 'Newton's Rings' (see 7.3.2.)

10.2

When viewed in accordance with Section 9.2 above the IGU will be deemed acceptable as long as, where appropriate, none of the following apply:

- there are no defects noticed that are visually disturbing
- any defects that are noted comply with the visual quality, (see 6), for the glass component
- any visual disturbance, e.g. from roller wave, bow, etc., is within the tolerances given in the appropriate product standard
- coated glass quality, e.g. pinholes, colour variation, etc. comply with the appropriate product quality
- condensation, internal or external, is not related to a seal failure
- distortion as a result of the framing system or the installation.

11 References

11.1 European and/or national standards

BS 952-1: Glass for glazing – Part 1. Classification

BS EN 572-1: Glass in building – Basic soda lime silicate glass products - Part 1: Definition and general physical and mechanical properties

BS EN 572-2: Glass in building – Basic soda lime silicate glass products - Part 2: Float glass

BS EN 572-3: Glass in building – Basic soda lime silicate glass products - Part 3: Polished wired glass

BS EN 572-4: Glass in building – Basic soda lime silicate glass products - Part 4: Drawn sheet glass

BS EN 572-5: Glass in building – Basic soda lime silicate glass products - Part 5: Patterned glass

BS EN 572-6: Glass in building – Basic soda lime silicate glass products - Part 6: Patterned wired glass
BS EN 572-8: Glass in building – Basic soda lime silicate glass products - Part 8: Supplied and final cut sizes

BS EN 1096-1: Glass in building – Coated glass products - Part 1: Description and definitions

BS EN 1096-2: Glass in building – Coated glass products - Part 2: Test method for the durability of class A, B and S coatings

BS EN 1096-3: Glass in building – Coated glass products - Part 3: Test method for the durability of class C and D coatings

BS EN 1279-1: Glass in building – Insulating glass units - Part 1: Generalities, dimensional tolerances and rules for the system description

BS EN 1748-1-1: Glass in building – Special basic product – Borosilicate glasses - Part 1-1: Definition and general physical and mechanical properties

BS EN 1748-2-1: Glass in building Special basic product – Glass ceramics Part 2-1: - Definition and general physical and mechanical properties

BS EN 1863-1: Glass in building – Heat strengthened soda lime silicate glass products - Part 1: Description and definitions

BS EN 12150-1: Glass in building – Thermally toughened soda lime silicate safety glass products - Part 1: Description and definitions

BS EN 12337-1: Glass in building – Chemically strengthened soda lime silicate glass – Part 1: Description and definitions

BS EN 13024-1: Glass in building – Thermally toughened borosilicate safety glass – Part 1: Description and definitions

BS EN 14178-1: Glass in building – Alkaline earth silicate glass products – Part 1: Float glass

BS EN 14179-1: Glass in building – Heat soaked thermally toughened soda lime silicate safety glass products – Part 1: Description and definitions

BS EN 14321-1: Glass in building – Thermally toughened alkaline earth silicate safety glass products – Part 1: Description and definitions

BS EN ISO 12543-1: Glass in building – Laminated glass and laminated safety glass - Part 1: Definitions and description of component parts

BS EN ISO 12543-2: Glass in building – Laminated glass and laminated safety glass - Part 2: Laminated safety glass

BS EN ISO 12543-3: Glass in building – Laminated glass and laminated safety glass - Part 3: Laminated glass

BS EN ISO 12543-4: Glass in building – Laminated glass and laminated safety glass - Part 4: Test methods for durability

BS EN ISO 12543-5: Glass in building – Laminated glass and laminated safety glass - Part 5: Dimensions and edge finishing

BS EN ISO 12543-6: Glass in building – Laminated glass and laminated safety glass – Part 6: Appearance

11.2 Evaluation of conformity/product standards

With the publication of the harmonised European standards, hENs, the glass components will become available as CE marked products. The CE marking will be a declaration that the glass product conforms to the appropriate hEN.

The hENs are as follows:

BS EN 572-9: Glass in building – Basic soda lime silicate glass products - Part 9: Evaluation of conformity/Product standard

BS EN 1096-4: Glass in building – Coated glass products - Part 4: Evaluation of conformity/Product standard

BS EN 1279-5: Glass in building – Insulating glass units - Part 5: Evaluation of conformity/Product standard

BS EN 1748-1-2: Glass in building – Special basic product – Borosilicate glasses - Part 1-2: Evaluation of conformity/Product standard

BS EN 1748-2-2: Glass in building Special basic product – Glass ceramics Part 2-2: - Evaluation of conformity/Product standard

BS EN 1863-2: Glass in building – Heat strengthened soda lime silicate glass products - Part 2: Evaluation of conformity/Product standard

BS EN 12150-2: Glass in building – Thermally toughened soda lime silicate safety glass products - Part 2: Evaluation of conformity/Product standard

BS EN 12337-2: Glass in building – Chemically strengthened soda lime silicate glass – Part 2: Evaluation of conformity/Product standard

BS EN 13024-2: Glass in building – Thermally toughened borosilicate safety glass – Part 2: Evaluation of conformity/Product standard

BS EN 14178-2: Glass in building – Alkaline earth silicate glass products – Part 2: Evaluation of conformity/Product standard

BS EN 14179-2: Glass in building – Heat soaked thermally toughened soda lime silicate safety glass products – Part 2: Evaluation of conformity/Product standard

BS EN 14321-2: Glass in building – Thermally toughened alkaline earth silicate safety glass products – Part 2: Evaluation of conformity/Product standard

BS EN 14449: Glass in building – Laminated glass and laminated safety glass - Evaluation of conformity/Product standard

11.3 GGF data sheets

Data Sheet 4.4. Heat treated glasses

Annex A

Appearance in reflection

A1 Problem due to lack of flatness

A1.1 General description

A glass, especially a thermally treated one, can rarely be glazed perfectly flat. This is a difficulty with the framing system, glazing system, installation and the inherent flatness of the glass.

Imagine a rectilinear feature, e.g. a telegraph pole, some 10 metres from a glazed panel. The observer is viewing the feature by reflection from a similar distance.

If the plane of the glazing changes by one tenth of one degree, 0.1° between two points on its surface, then the viewer will see either two images apparently displaced by 70mm or one image distorted by this amount.

A1.2 Is one tenth of one degree, 0.1° , significant?

YES. This amount of flatness change is equivalent to a deflection of 0.8mm over a one-metre length.

This should be compared with the allowable deflection limits for framing, i.e. $L/125$ for single glazing, $L/175$ for double glazing. This would mean for an L of 1 metre deflections of either 8mm for single-glazing or 5.7mm for double-glazing.

Deflections of greater magnitude can occur due to wind-loading. For thermally treated glass, i.e. thermally toughened, heat strengthened, etc., the standards allow overall bows of 2mm/m and local bows of 3mm/300mm.

For insulating glass units the deflection due to barometric/temperature effects can be significantly greater than 0.8mm/m.

A1.3 Optical explanation

Figure A1 shows the geometry involved.

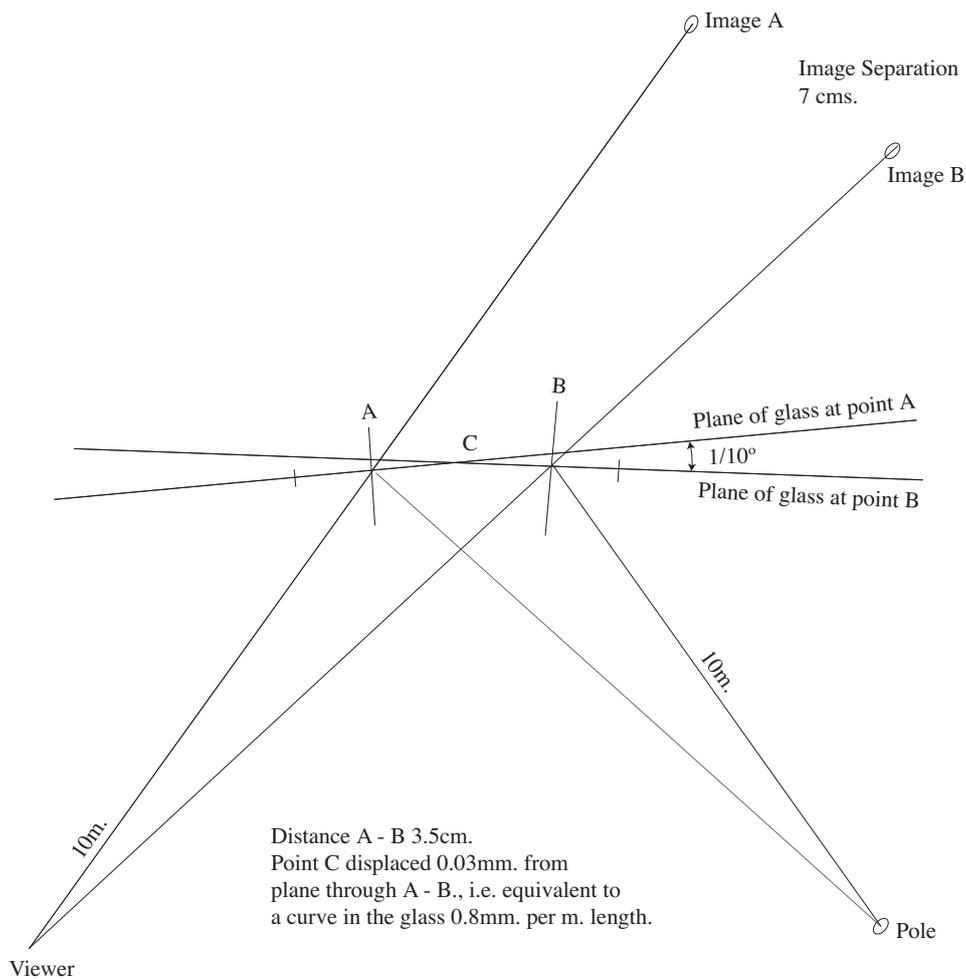


Figure A1 Explanation of lack of flatness

Annex B

Diagrammatic explanation:

Phenomena exhibited by IGUs as a result of their inherent properties

B1 Multiple images

B1.1 General

When light hits a smooth glass surface; some is transmitted through, some is reflected and some is absorbed.

It is a law of physics that the angle of incidence is equal to the angle of reflection. Therefore if the incident ray is at normal incidence, i.e. at right angles to the glass surface then it is reflected directly back, (see Figure (B1A)). If the incident ray falls obliquely on the surface then the reflected ray bounces back at the same angle but on the other side of the perpendicular; (see Figure (B1B)).




Figure B1(A)




Figure B1(B)

B1.2 Refraction

Another law of physics is that when a ray enters a medium of differing density it is bent (refracted).

When a ray enters the glass from the air the angle of refraction is less than the angle of incidence. Therefore when reflected from the second surface it is displaced with respect to the incident ray.

When the ray leaves the glass into the air the angle of refraction is greater than the angle of incidence. Therefore when leaving the first pane of glass the ray is parallel to the incident ray but displaced.

A similar situation occurs when the ray meets the second pane.

For each pane of glass there are two reflected images, a primary and a secondary image. The primary images result from surfaces 1 and 3 and the secondary images from surfaces 2 and 4, (see Figure B2).




Figure B2

B1.3 Influencing factors

The following will increase the spacing between images:

- Increasing glass thickness,
- Increasing cavity width,
- Decreasing the angle of incidence.

The effects of coatings and body tints are dependent upon their spectrophotometric properties, i.e. transmittance, reflectance, absorbance, and their position.

Generally body tinted glasses will enhance the primary image and reduce the secondary image produced by the pane. Coatings will enhance the image reflected from the coating.

B2 Distorted images

B2.1 General

When light rays strike a curved glass surface, they reflect in different directions. However, they will still obey the law that the angle of incidence equals the angle of reflection. Therefore the image of an object will be distorted. The curvature of the glass surface causes it to act as a lens.

B2.2 Concave curvature

This is when the surface is bowed inwards.

A concave curvature will cause the light rays to be projected inwards towards a central point. This causes the reflected image to appear short and thin, (see Figure B3 (A)).




Figure B3(A)

B2.3 Convex curvature

This is when the surface is bowed outwards.

A convex curvature will cause the light rays to be projected outwards away from a central point. This causes the reflected image to be stretched out in all directions, (see Figure B3 (B))

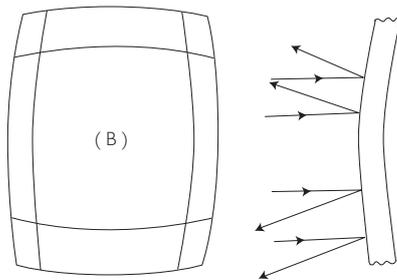


Figure B3(B)

The outcome of having different curvatures on the panes will result in some images being made smaller/thinner and others being stretched out.

Note: Figure B4 only examines the first reflection of the light ray.

B3 Composite factors

The combination of multiple images, B1, and distorted images, B2, is extremely difficult to describe.

What is certain is that nothing can be done to stop these effects occurring.

B2.4 Curvature in IGUs

When an IGU is subjected to barometric and/or temperature and/or altitude effects the whole unit will change shape.

If the effects on the unit cause it to shrink inwards then this will result in pane #1 being concave and pane #2 being convex, (see Figure B4 – Type (A)). Similarly if the effects on the unit cause it to swell outwards then this will result in pane #1 being convex and pane #2 being concave, (see Figure B4 – Type (B)).




Figure B4(A)

Surface 1 - Primary image - shrunk
Surface 3 - Primary image - spreadout




Figure B4(B)

Surface 1 - Primary image - spreadout
Surface 3 - Primary image - shrunk